

FirePro System General Arrangement

15-10-19

No

PTS-800-1

В

INSTALLED VIEW 0 0 0

Notes:

- 2 Dimensions are in MM
- 3 Holes in Bracket are for M10 Bolts
- 4 Mount Standard FirePro Bracket as shown

| | | | FIRE SAFE |
|----------|-------------|-------|----------------|
| Drawn By | Approved By | Title | |
| PM | | | Atlas (|
| Scale | Date | | |
| No | 15-10-19 | | FirePro Syster |

PTS-800

Standard FirePro Bracket

1 Bracket Material - Mild Steel Bar 40 x 10mm - Painted


ETY EQUIPMENT PTY LTD

Copco PTS-800 m General Arrangement Drawing No


PTS-800-2

В

PTS-800

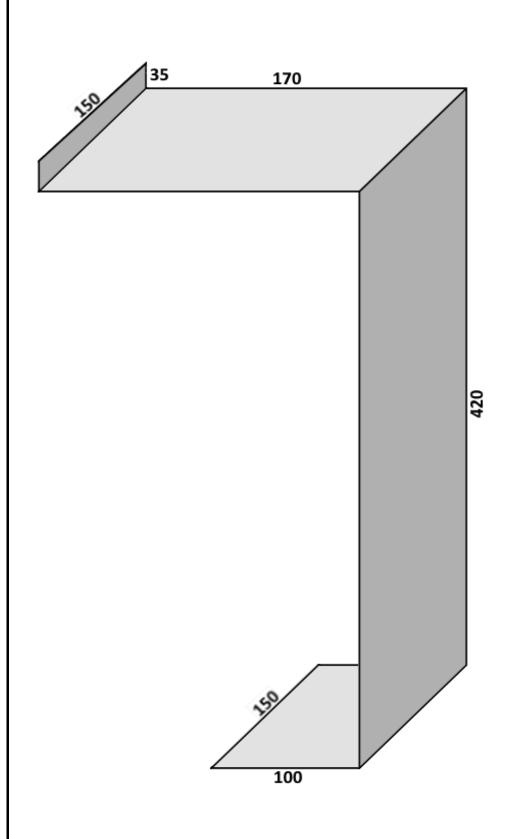



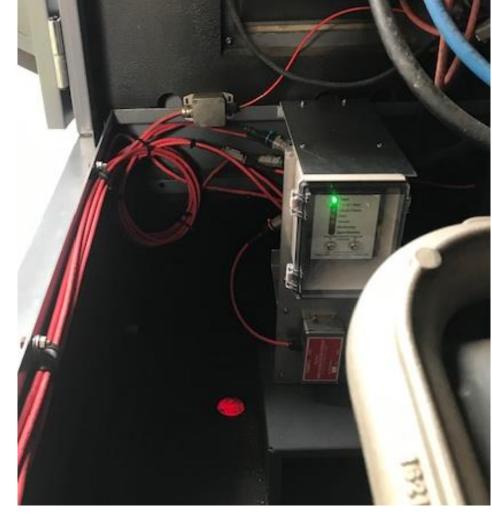

Notes:

- 1 Dimensions are in MM
- 2 Material Marine Grade Aluminium 3 mm

| | | | FIRE SAFE |
|----------|-------------|-------|-------------|
| Drawn By | Approved By | Title | |
| PM | | | Atlas |
| Scale | Date | | |
| No | 15-10-19 | Fir | ePro Syster |

SIDE VIEW

TOP VIEW

INSTALLED VIEW

ETY EQUIPMENT PTY LTD

s Copco PTS-800 em General Arrangement

Drawing No

PTS-800-3

В

| | | | PTS-800 | | | | | | |
|-------------|-----|--|---|----------------------|----------------|--|--|--|--|
| Part No | Qty | | BILL OF I Description | MATERIALS Part No | Qty | | | | |
| FP-0500S | 2 | -te- | 500g SS Aerosol Generator | FP-08860 | 1 | 17-5120 EINE Fandon Seren & SHUTDOWN NODULE Seren & SHUTDOWN NODULE IN OPDIALE BOO THE BOO THE | Shutdown Module - | | |
| FP-06200 | 4 | | HD SS Bracket to suit 100 - 500 | FP-08872 | 1 | | Battery Backup Mod | | |
| FP-08800 | 1 | NORMAL MARKET & Product Market & Normal Market | FirePro Test Module | FP-14053 | 2 | FIRE | External Actuator Sw | | |
| FP-06920 | 1 | | Dust Seals – to suit 100-500 | FP-14016 | 1 | 0 | Battery cable connec 2 Pin Male Deutsch R | | |
| FP-08451 | 1 | Concerned & Authorities regionse Plane Pla | Control Panel - FirePro detection and Activation Panel | FP-09500 | 30 | | Cable 2 core 0.75mn | | |
| FP-08918 | 1 | | Splitter Cable, Red, No TVS | FP-08825 | 1 | \checkmark | Thermal Fuse with C | | |
| X-PTS-800-3 | 1 | | Control Panel Bracket | FP-08940 | 1 | | Siren / Strobe with E | | |
| DP-3010 | 2 | N N N N N N N N N N N N N N N N N N N | Deutsch Plug – 3 Pin Male, c/w pins and heatshrink to suit | FP-09510-08 | 1 | \bigcirc | Linear Heat Detectio with 2 pin Deutsch P | | |
| DP-3020 | 2 | | Deutsch Plug – 3 Pin Female, c/w pins and heatshrink to suit | Misc | 16 | | P-clips to suit FP-095 | | |
| DP-2010 | 4 | | Deutsch Plug – 2 Pin Male, c/w pins and heatshrink to suit | FP-08961 | 1 | | Sign - System Warniı | | |
| DP-2020 | 4 | | Deutsch Plug – 2 Pin Female, c/w pins and heatshrink to suit | FP-08950 | 2 | | End of Line Resistor | | |
| FP-08945 | 1 | A B | WaterProof Enclosure for Control Panel | | | | | | |
| | | | | | | | FIRE SAFETY | | |
| | | | | | Drawn By PM | Approved By | Fitle | | |
| | | | | | Scale NO | Date 15-10-19 | Atlas Copo FirePro System Ge | | |
| | | | | | - | | | | |

e - to suit 8451

odule 12-24vDC NiMH

Switch with Bracket

nection x 3m with 5A Fuse h Plug and Ballery Terminal Connectors

nm Shielded FR x 1m

Coupling

EOL diode Installed

ion 180deg C Cable x 8m Plugs fitted

9510 LHD

ning Vinyl - Vehicle

Y EQUIPMENT PTY LTD

Atlas Copco PTS-800 FirePro System General Arrangement Drawing No