

Y - 1260 with XC4004 Controller





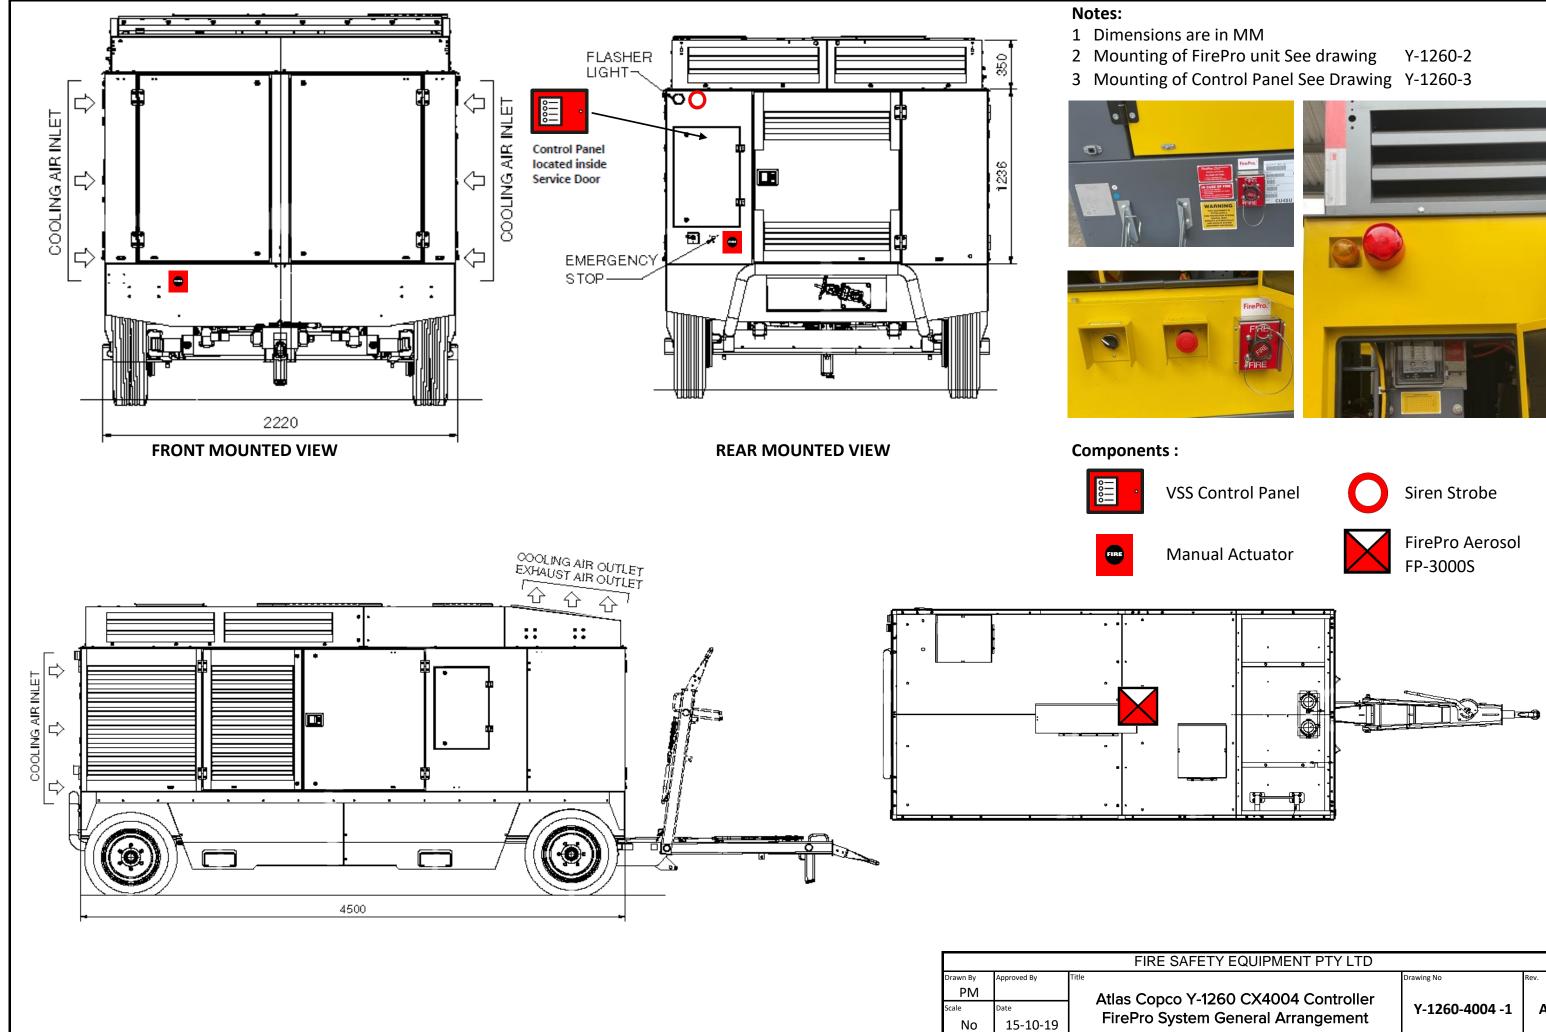




FETY EQUIPMENT PTY LTD		
	Drawing No	Rev.
Y-1260 CX4004 Controller em General Arrangement	Y-1260-4004 -1	Α



Y-1260 with XC4004 Controller

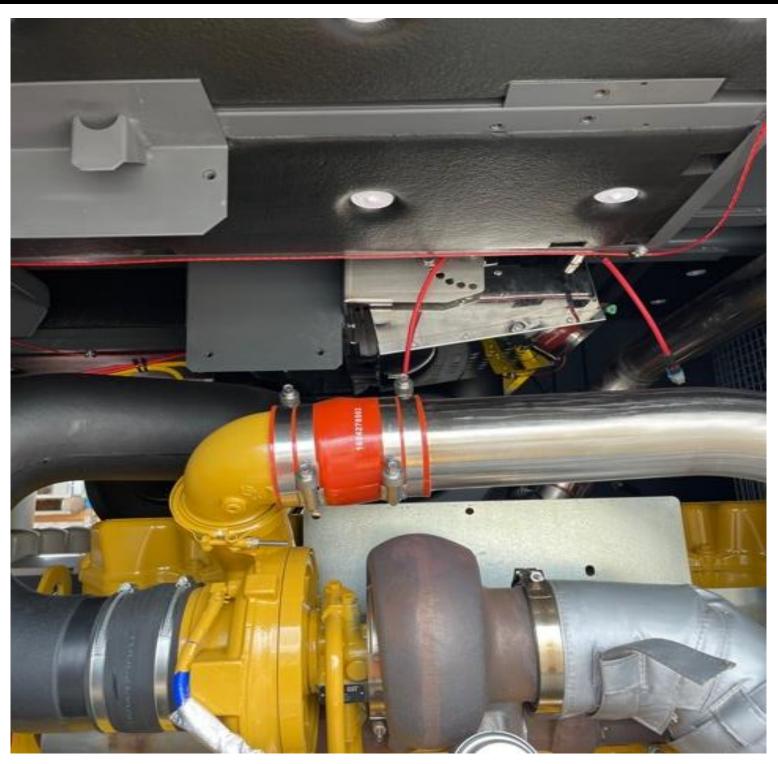

Notes:

- 1 Standard FirePro FP-06100 Bracket used
- 2 Mounted to Existing Steel Bulkhead in Unit
- 3 Holes in Bracket are for M8 Bolts

			FIRE SAF
Drawn By	Approved By	Title	
PM			Atlas Copco Y
Scale	Date		•
No	15-10-19		FirePro A

DO Bracket used el Bulkhead in Unit VI8 Bolts


FETY EQUIPMENT PTY LTD

Y-1260 XC4004 Controller Aerosol Unit Mounting Drawing No


Y-1260-4004-2

...


Α

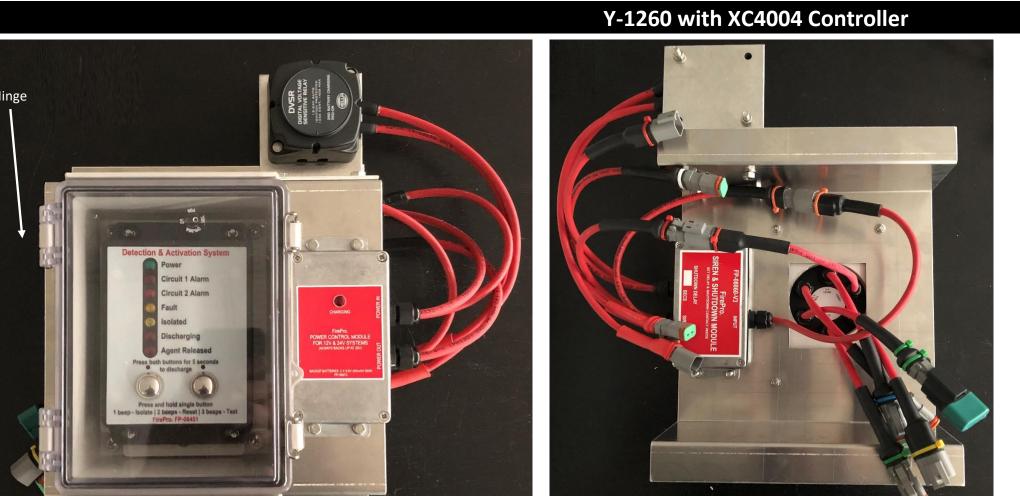



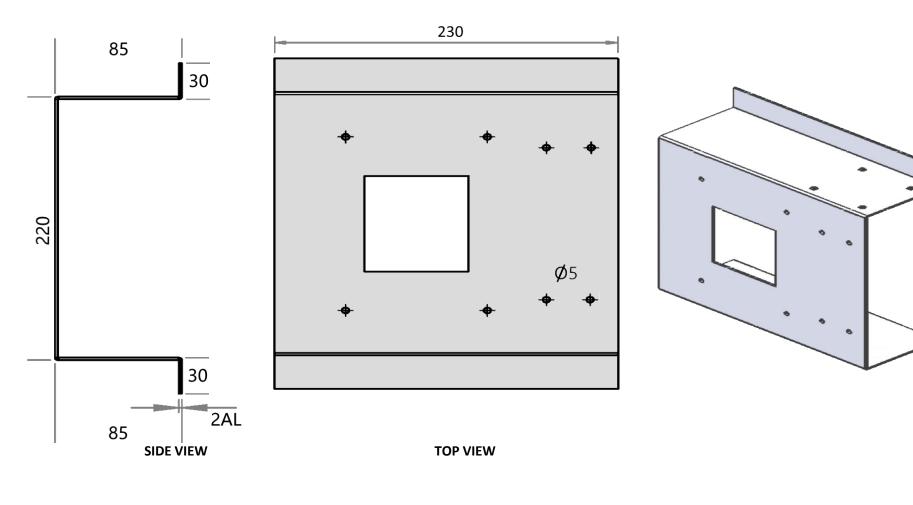

REAR MOUNTED VIEW

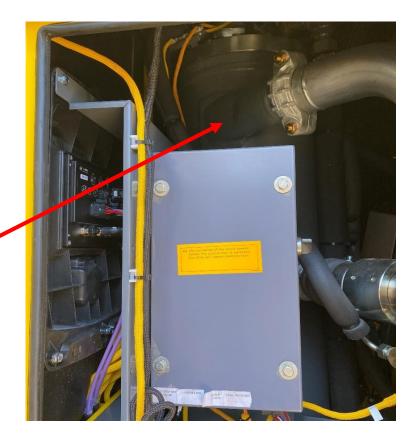

Notes:

Panel Location

- 2 Dimensions are in MM

FIRE SAFE			
	Title	Approved By	Drawn By
Atlas Copco Y-			PM
•	1	Date	cale
FirePro Panel		15-10-19	No

INSTALLED VIEW



1 Bracket Material - Marine Grade Aluminium 2mm Unpainted

3 Bracket has Provision for all Control Modules on Front 4 Bracket mounts on Predrilled & tapped 8mm holes on floor plate

ETY EQUIPMENT PTY LTD

-1260 XC4004 Controller Control Panel Mounting

rawing No

			Y-1260 with	XC40		ler		
Part No	Qty	_	Description		Part No	Qty	_	
FP-3000S	1		3000g SS Aerosol Generator	F	-P-08860	1	FFAILD INFE SIREN SSIELDON NOOLLE UTE ALLEGON INFE ILE FRI ILE FRI ILE FRI	Shutdown Module - t
FP-06100	1	and the second	HD SS Bracket to suit 1200 - 5700	F	-P-08872	1		Battery Backup Modu
FP-08800	1	NOTE BEEN AND AND AND AND AND AND AND AND AND AN	FirePro Test Module	F	-P-14053	2	FIRE	External Actuator Sw
FP-06910	1		Dust Seals – to suit FP1200-5700	F	-P-14016	1	O	Battery cable connec 2 Pin Male Deutsch P
FP-08451	1	Calculation - 4 Address Special Mark Size: Venil Size: Venil Size: Venil Annonya Agestineare Venil Ven	Control Panel - FirePro detection and Activation Panel	F	-P-09500	30		Cable 2 core 0.75mm
X-Y1260-2	1		Special Bracket for Mounting Control Equipment on Atlas Copco Y-1260 Compressor	F	-P-08825	1	\bigvee	Thermal Fuse with Co
DP-3010	2	N AND	Deutsch Plug – 3 Pin Male, c/w pins and heatshrink to suit	F	-P-08940	1	100	Siren / Strobe with E
DP-3020	2		Deutsch Plug – 3 Pin Female, c/w pins and heatshrink to suit	F	-P-09510-08	1	\bigcirc	Linear Heat Detection with 2 pin Deutsch Pl
DP-2010	4		Deutsch Plug – 2 Pin Male, c/w pins and heatshrink to suit	٦	Visc	16	Ð	P-clips to suit FP-095
DP-2020	4		Deutsch Plug – 2 Pin Female, c/w pins and heatshrink to suit	F	P-08961	1		Sign - System Warnin
FP-08950	2		End of Line Resistor	F	-P-08879	1	Dire Dire Station Station	Voltage Sensitive Rel
FP-08945	1		WaterProof Enclosure for Control Panel					
						Drawn By	Approved By	FIRE SAFETY
						DN/		

Description

- to suit 8451

dule 12-24vDC NiMH

Switch with Bracket

ection x 3m with 5A Fuse Plug and Ballery Terminal Connectors

nm Shielded FR x 1m

Coupling

EOL diode Installed

ion 180deg C Cable x 8m Plugs fitted

9510 LHD

ning Vinyl - Vehicle

lelay

PM

No

ate

15-10-19

cale

TY EQUIPMENT PTY LTD

Atlas Copco Y-1260 XC4004 Controller Bill of Materials rawing No

ev.